

S6040A1003/S6065A1003/S6065A2001 AIR & LIQUID FLOW SWITCHES

DATA & MOUNTING INSTRUCTIONS



S6065A2001

S6040A1003

S6065A1003

GENERAL

The air and liquid flow switches of the S6040 and S6065A series are designed for monitoring flow rates in pipes and ducts employed in HVAC applications.

The S6040A1003 Air Flow Switch monitors air flow and the flow of non-aggressive gases in the air ducts of air conditioning systems and air treatment systems.

The liquid flow switches of the S6065A series are suitable for monitoring flow in oil, cooling circuits, and lubrication systems.

FEATURES

- Cost-effective switches for HVAC applications.
- High-capacity, fully-encapsulated NC/NO micro-switch
- A single type suitable for pipes with a diameter of 1 to 8".

COMMON SPECIFICATIONS

Switching capacity	15 (8) A, 24...250 Vac
Lifetime	50000 cycles at nominal load
Working temperature	-40 °C ... +85 °C
Electrical connection	Screw terminal, wire up to 1.5 mm ² cable Ø 6...9 mm
Protection class	I according to EN60730
Protection standard	IP65 according to EN60529
Housing material	ABS and corrosion-protected steel

MODELS

Specification	S6040A1003	S6065A1003	S6065A2001
Flow medium	air	non-aggressive liquid	aggressive liquid
Mounting	vertically through a 20-mm hole in the duct; mount paddle inside	Rp 1" (ISO7/1)	Rp 1" (ISO7/1)
Maximum duct/pipe temperature	85 °C	120 °C	120 °C
Pressure	0.25 bar	11 bar	30 bar
Paddle material	V2A	V4A	V4A
Lever	yellow brass	yellow brass	V4A
Housing dimensions	108 x 70 x 72 mm	113 x 70 x 65 mm	108 x 70 x 72 mm
Weight	700 g	850 g	850 g
Approvals	--	TÜV-approved	TÜV-approved

MOUNTING

Mounting the S6040A1003

The S6040A1003 Air Flow Switch (with separate paddle) is mounted in the vertical position (i.e. with the switch box at the top). Necessary flow smoothing distance: min. five times the diameter of duct before and behind the switch!

The device must be mounted with the package-included seal plate through an approx. 20-mm hole in the duct. The device must be fixed with two package-included screws. The paddle must then be mounted with a screw on the shaft inside of the duct.

Mounting the S6065A1003 and S6065A2001

The S6065A1003 and S6065A2001 Liquid Flow Switches can be mounted in any desired position far from elbows, valves, and filters. The arrow on the housing must point downstream. In the case of vertical pipes, reset the range to balance the paddle weight. To prevent malfunction caused by impurities in the medium, do not mount the device with the housing pointing downwards.

SWITCH-POINT ADJUSTMENT

S6040A1003 Air Flow Switch

Min. switch point: approx. 2.5 m/s; reset point: 1 m/s.
 Max. switch point: approx. 9.2 m/s; reset point: 8.0 m/s.


S6065A1003 and S6065A2001 Liquid Flow Switches

The flow switch is factory-set to the min. flow rate (= low flow speed). To adjust the device to a certain switch level, turn the adjustment screw clockwise. Table 1 lists the reset points and switch points at the minimum and maximum flow rates for various pipe diameters.


Table 1. Reset and switch points

Pipes DN	Paddle	Reset and switch point (m ³ /h)			
		min. flow rate		max. flow rate	
		reset pt.	switch pt.	reset pt.	switch pt.
1"	short	0.6	1.0	2.0	2.1
1-1/4"	short	0.8	1.3	2.8	3.0
1-1/2"	short	1.1	1.7	3.7	4.0
2"	short	2.2	3.1	5.7	6.1
2-1/2"	short	2.7	4.0	6.5	7.0
3"	short	4.3	6.2	10.7	11.4
3-1/2"	short	11.4	14.7	27.7	29.0
4"	long	6.1	8.0	17.3	18.4
5"	short	22.9	28.4	53.3	55.6
5"	long	9.3	12.9	25.2	26.8
6"	short	35.9	43.1	81.7	85.1
6"	long	12.3	16.8	30.6	32.7
8"	short	72.6	85.1	165.7	172.5
8"	long	38.6	46.5	90.8	94.2

FIELD WIRING

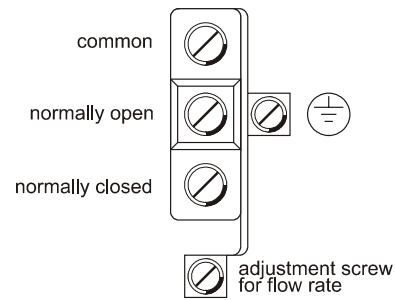

DIMENSIONS

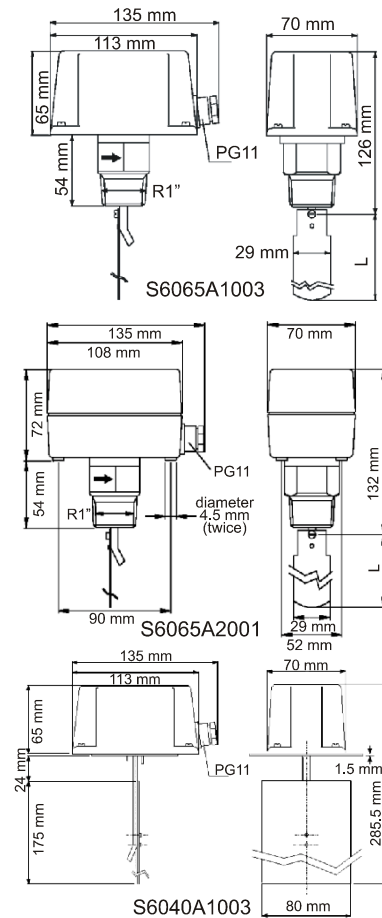

Honeywell



Fema Controls

Honeywell AG

P.O. Box 1254

D-71099 Schönaich

Phone: (49) 7031-637-02

Fax: (49) 7031-637-850

http://honeywell.de/fema

Subject to change without notice. Printed in Germany

Manufacturing location certified to

**DIN EN ISO
9001/14001**

EN0B-0314 GE51R0501